

**Weather station Plus**  
Order No. : 2074 00

**Operating instructions**

**1 Safety instructions**



Electrical devices may only be mounted and connected by electrically skilled persons.

Serious injuries, fire or property damage possible. Please read and follow manual fully. These instructions are an integral part of the product, and must remain with the end customer.

**2 Device components**

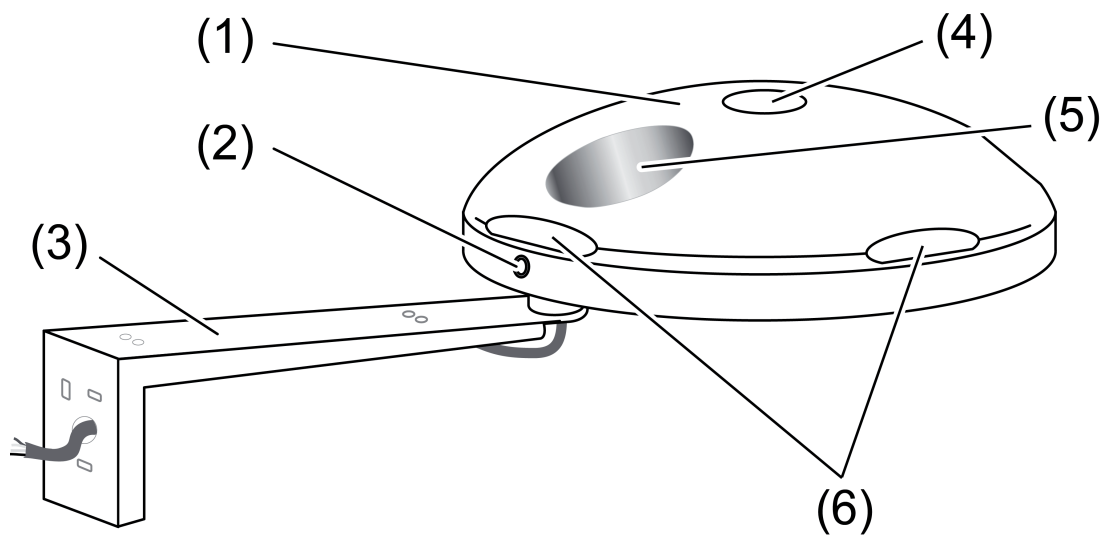


Figure 1: View

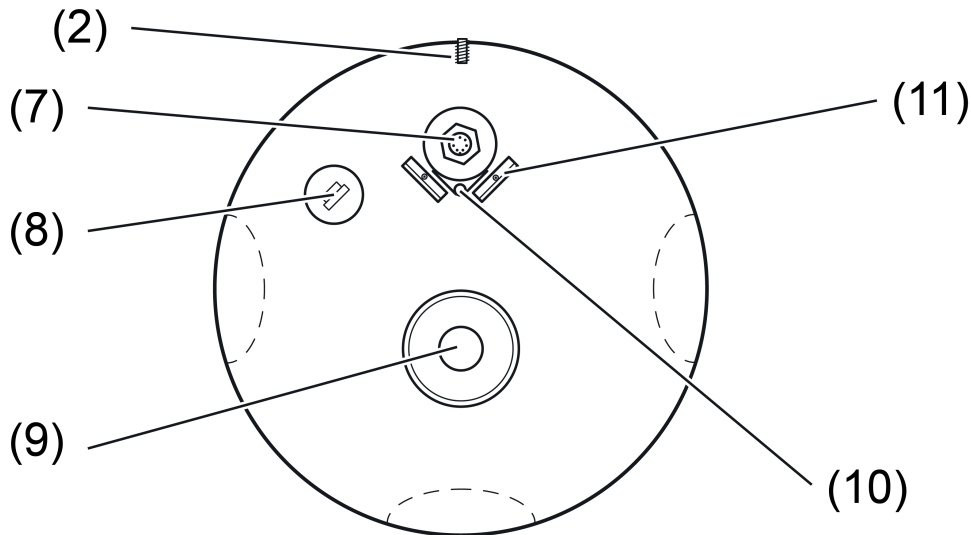


Figure 2: Underside view

- (1) Sensor head
- (2) Grub screw for locking
- (3) Fastening arm
- (4) Global radiation sensor
- (5) Precipitation sensor
- (6) Light and twilight sensors
- (7) Mounting for fastening arm with bus connection
- (8) Air humidity sensor
- (9) Wind speed and wind direction sensor
- (10) Temperature sensor
- (11) Guide blade  
(only if mounted on a mast)

### 3 Function

#### System information

This device is a product of the KNX system and complies with the KNX directives. Detailed technical knowledge obtained in KNX training courses is a prerequisite to proper understanding.

The function of this device depends upon the software. Detailed information on loadable software and attainable functionality as well as the software itself can be obtained from the manufacturer's product database. Planning, installation and commissioning of the device are carried out with the aid of KNX-certified software. The latest versions of product database and the technical descriptions are available on our website.

#### Intended use

- Measurement and evaluation of weather data: Wind speed, Wind direction, Precipitation, Brightness, Global radiation Twilight, Temperature, Relative air humidity and Air pressure
- Installation on the outside of buildings, preferable in the roof and facade area
- Operation with additional power supply (see accessories)

#### Product characteristics

- Integrated GPS/GLONASS receiver for automated positioning
- Calculation of additional weather data: Absolute air humidity, chill temperature, comfort
- Function for shading control
- Integrated KNX bus coupling unit
- Measurement data acquisition and limit value monitoring
- Software logic modules for linking events
- Integrated heating

- i** The measured values apply to the mounting location. Variations to other weather services – e.g. through local turbulence or areas with build-ups of air – are possible.

## 4 Information for electrically skilled persons



### **DANGER!**

**Electrical shock on contact with live parts in the installation environment.  
Electrical shocks can be fatal.**

**Before working on the device, disconnect the power supply and cover up live parts in the working environment.**

## 4.1 Fitting and electrical connection

### Selecting the installation location

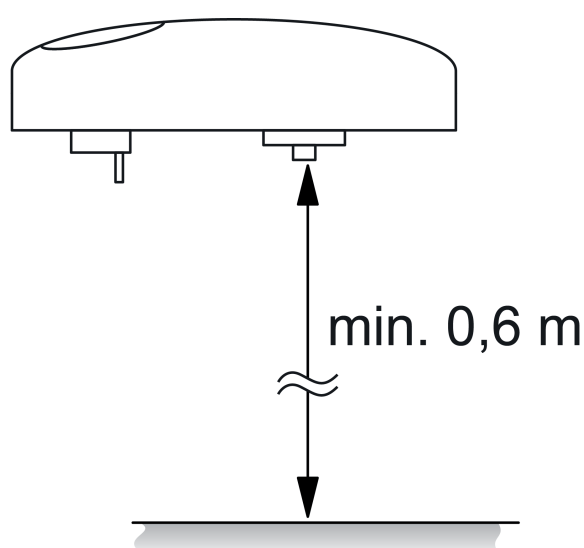


Figure 3: Minimum distance to surfaces

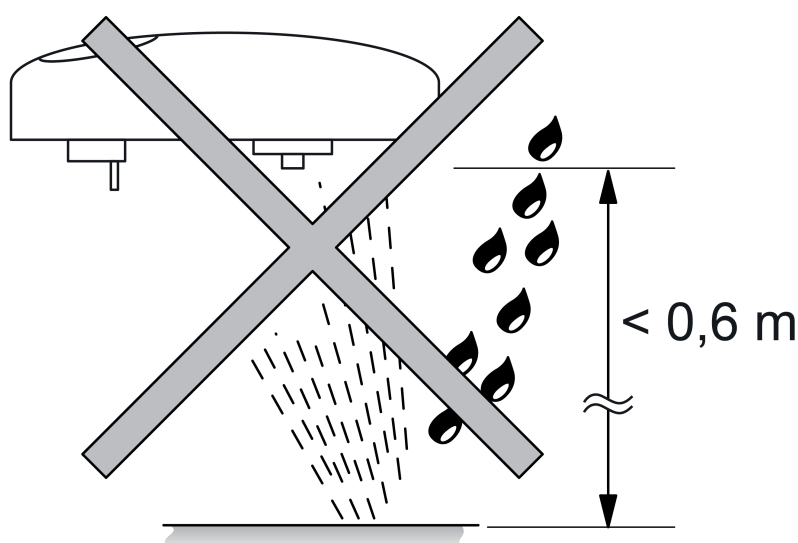


Figure 4: Avoid spray water

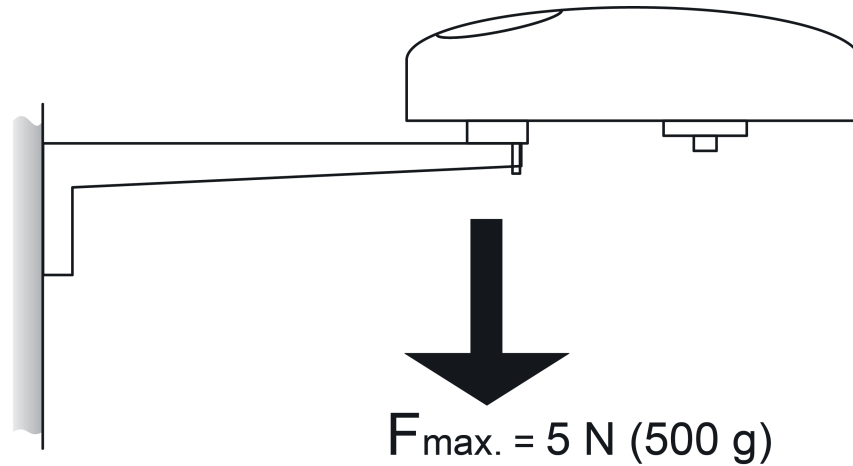


Figure 5: Maximum load on the fastening arm

Select a mounting selection in which the weather station is not influenced by local obstacles or shading, such as surrounding trees, chimneys, awnings, etc. The sensor must be able to detect wind, rain and ambient brightness without impedance. Avoid slipstream, shadow casting and light reflection.

Preferred mounting on a freestanding mast. If mounted on house walls, the measurement of wind and brightness in particular can be distorted.

Do not mount it below or next to building sections, from which water can drip onto the device.

Select the mounting location so that the weather station will be accessible.

In the case of flat roofs, locate the weather station as close to the centre of the roof as possible.

Minimum distance to surfaces below the weather station: 0.6 m (Figure 3). Otherwise, the sensors on the underside may get damaged by penetrating spray water (Figure 4).

Direct sunlight, chimneys or other waste gas or ventilation systems affect the temperature measurement.

Do not operate in the vicinity of radio transmitter systems. Doing so will compromise function.

**i** Do not connect more than 3 weather stations in a KNX line.

### Mounting weather station without fastening arm on freestanding mast

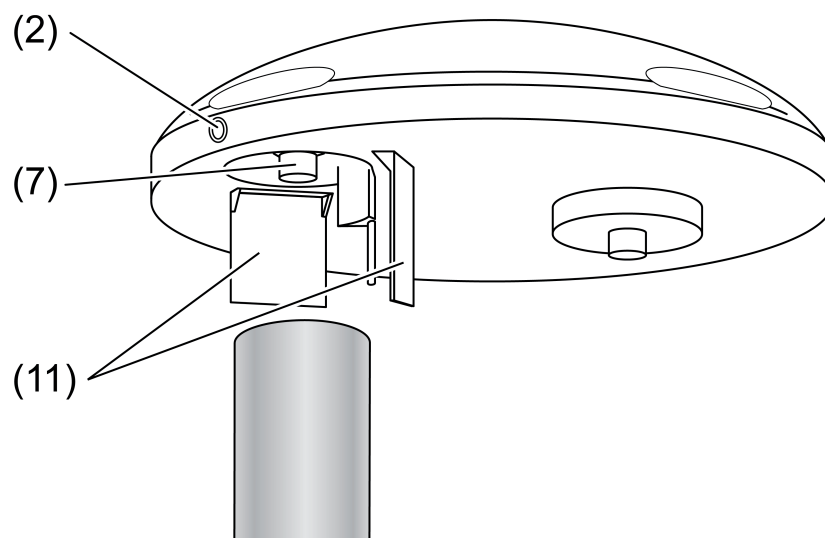


Figure 6: Mounting on freestanding mast without fastening arm

Use mast with outer diameter <25 mm and inner diameter >19 mm.

- Mount enclosed guide blade (11) in the fields provided next to the connection (7).
- ❗ If mounted on a mast without the guide blade, no correct wind direction measurement is possible due to the resulting turbulences.
- Route the power supply line through the mast.
- Attach the 7-pin plug to the connection (7). Tighten threaded ring with max. 0.5 Nm.
- Mount weather station onto the mast and align. The grub screw (2) must be pointing north.
- Tighten grub screw (2) with max. 0.6 Nm.

#### Mounting weather station with fastening arm on mast or wall

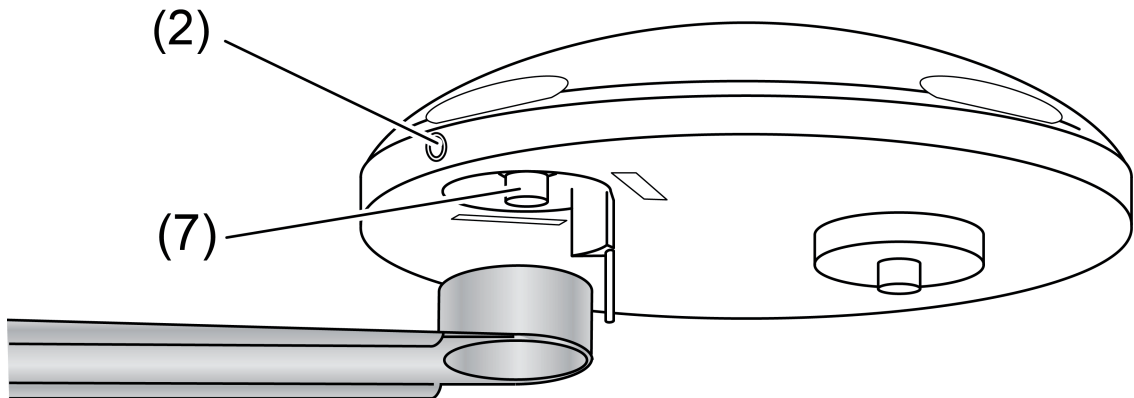


Figure 7: Mounting with fastening arm

Mount enclosed fastening arm onto a suitable mast or wall.

The enclosed hose clamps are suitable up to a maximum mast diameter of 60 mm.

- ❗ If mounted on the supplied fastening arm, do not mount the enclosed guide blade.
- Mast mounting: Attach fastening arm to mounting mast using the enclosed hose clamps.
- Wall mounting: Attach fastening arm to the wall through the boreholes (Figure 8) using suitable screws.
- Route the power supply line along the underside of the fastening arm and guide the 7-pin plug through the open pipe socket at the end of the fastening arm.
- Attach the 7-pin plug to the connection (7). Tighten threaded ring with max. 0.5 Nm.
- Mount weather station onto the mast and align. The grub screw must be pointing north.
- Tighten grub screw with max. 0.6 Nm.
- Route the power supply line through the cable bushing into an installation pipe.

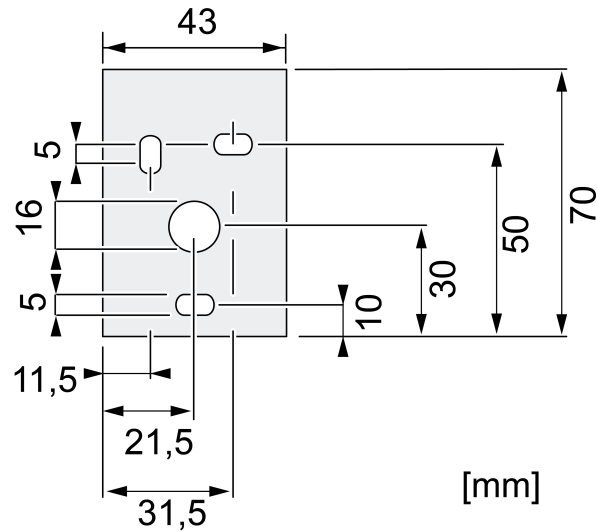


Figure 8: Fastening arm – dimensions for boreholes

### Mounting and connecting the device

- Connect bus line and external power supply to power supply line.

red	KNX+
Black	KNX-
orange	AC/DC 24 V ~/+
brown	AC/DC 24 V ~/-

- i** The sensor head is translucent. Therefore, do not stick or write on the sensor head.

### Aligning the device

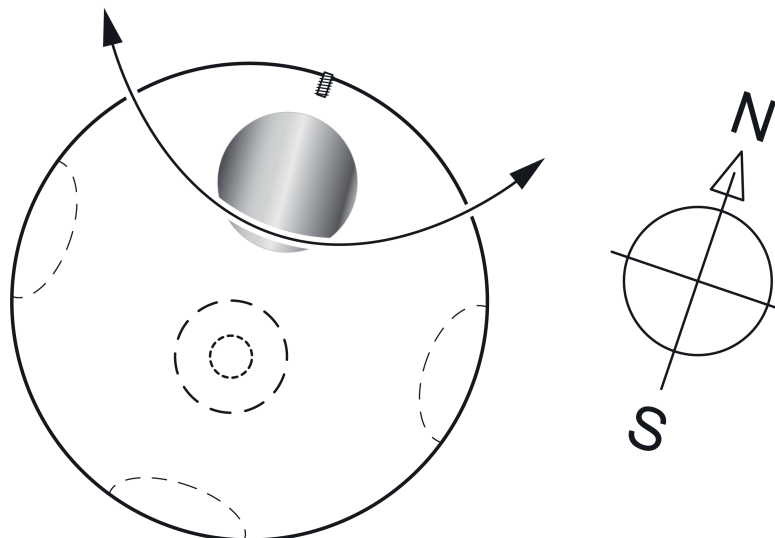


Figure 9: Orienting the weather station

- Align the sensor head in the appropriate direction or - depending on the detailed on-site circumstances - according to the alignment of the facade (Figure 9).

## 4.2 Commissioning

### Commissioning the device

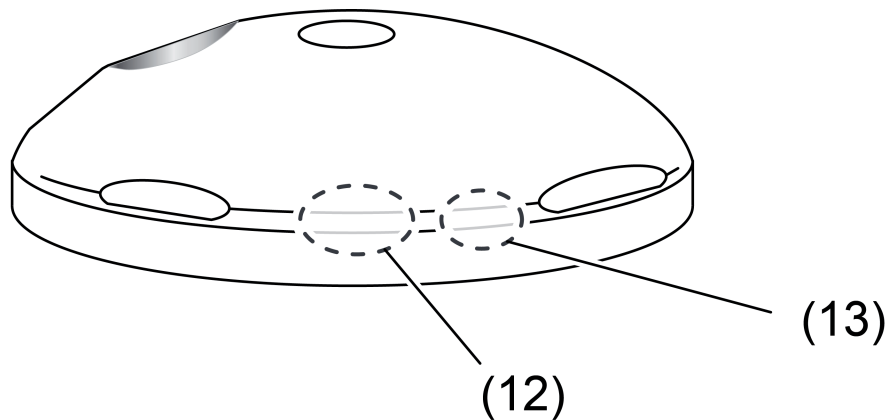



Figure 10: Position of the programming LED and reed contact


- Switch on the bus voltage.
- Switch on supply voltage.
- Hold the supplied programming magnet by the integrated reed contact (12).  
The programming LED (13) indicates the programming state blue.
- Assign physical addresses and load application software into the device.
- Note the physical address on adhesive labels on the underside.  
The device is ready for operation.

## 5 Appendix

### 5.1 Technical data

Supply	
Rated voltage	AC 24 V SELV ( $\pm 10\%$ )
Rated voltage	DC 21 ... 32 V SELV
Current consumption	100 ... 400 mA (dependent on the weather)
Protection class	III
Connection cable	
Cable type	LiYCY 4xAWG26
Cable length	5 m
Total length per line	15 m
Number of weather stations	max. 3 (per line)
KNX	
KNX medium	TP
Commissioning mode	S-mode
Rated voltage KNX	DC 21 ... 32 V SELV
Current consumption KNX	max. 5 mA
Ambient conditions	
Ambient temperature	-30 ... +60 °C
Storage/transport temperature	-25 ... +70 °C
Degree of protection	IP 44 (in position for use)
Housing	
Dimensions $\varnothing \times H$	130x68 mm
Weight	approx. 230 g
Wind direction sensor	
Measuring range	1 ... 360°

Resolution	1°
Accuracy	± 10 ° (laminar wind stream)
Wind speed sensor	
Measuring range	approx. 0 ... 40 m/s
Resolution	0.1 m/s
Accuracy (≤ 10 m/s)	± 1 m/s
Accuracy (>10 m/s)	± 5 %
 Accuracy as RMS average value over 360°.	
Temperature sensor	
Measuring range	-30 ... +60 °C
Resolution	0.1 K
Accuracy	± 1 K (Wind > 2 m/s, for -5 ... +25 °C)
Precipitation sensor	
Measuring range	yes/no
Accuracy	Fine drizzle
Brightness sensors	
Number	4
Measuring range	approx. 0 ... 150 klx
Resolution	1 klx
Accuracy	± 3 %
Spectral range	475 ... 650 nm
Twilight sensor	
Measuring range	approx. 0 ... 900 lx
Resolution	1 lx
Accuracy	± 10 lx
Air pressure sensor	
Measuring range	300 ... 1100 hPa
Resolution	0.01 hPa
Accuracy	± 0.5 hPa (20°C)
Humidity sensor	
Measuring range	0 ... 100 % rel. humidity
Resolution	0.1 % rel. humidity
Accuracy	± 10 % rel. humidity (20°C)
abs. humidity	0 ... 400 g/m <sup>3</sup>
Resolution	0.01 g/m <sup>3</sup>
Global radiation	
Measuring range	0 ... 1300 Watt/m <sup>2</sup>
Resolution	1 Watt/m <sup>2</sup>
Accuracy	± 10 %
Spectral range	350 ... 1100 nm

 All accuracy specifications relate to the respective measuring range end value.

## 5.2 Accessories

Power supply

Order No. 1024 00

## 5.3 Warranty

The warranty follows about the specialty store in between the legal framework as provided for by law

Please submit or send faulty devices postage paid together with an error description to your responsible salesperson (specialist trade/installation company/electrical specialist trade). They will forward the devices to the Gira Service Center.



KNX

Weather station Plus

# GIRA

---

**Gira**  
**Giersiepen GmbH & Co. KG**  
Elektro-Installations-  
Systeme

Industriegebiet Mermbach  
Dahlienstraße  
42477 Radevormwald

Postfach 12 20  
42461 Radevormwald

Deutschland

Tel +49(0)21 95 - 602-0  
Fax +49(0)21 95 - 602-191

[www.gira.de](http://www.gira.de)  
[info@gira.de](mailto:info@gira.de)